

- A. ALL LOW VOLTAGE LIGHTING DEVICES TO BE CONNECTED WITH CATSE CABLE PER MANUFACTURER REQUIREMENTS. PROVIDE 3/4" CONDUIT FOR CATSE WIRE IN ALL EXPOSED LOCATIONS.
- KEYED NOTES:♦
- INSTALL POWER PACK UNIT ABOVE CEILING AT LOCATION SHOWN. ROUTE SWITCHING CIRCUITS AS INDICATED AND PROGRAM SYSTEM FOR INDIVIDUAL CONTROL OF EACH SWITCH CIRCUIT BY DEVICE OR DEVICES IN SPACE.
- 2. CONNECT EMERGENCY AND EXIT LIGHT FIXTURE TO UNSWITCHED POWER CIRCUIT.
- 3. INSTALL OCCUPANCY/VACANCY SENSOR ON CEILING PER MANUFACTURER REQUIREMENTS. DAISY CHAIN DEVICES WHERE INDICATED. FIELD COORDINATE FINAL LOCATIONS.
- 4. CONNECT EXTERIOR LIGHTING TO CHANNEL 1 OF TIME CLOCK. SEE "TIME CLOCK DETAIL".



ELECTRICAL LIGHTING PLAN: FIRST FLOOR

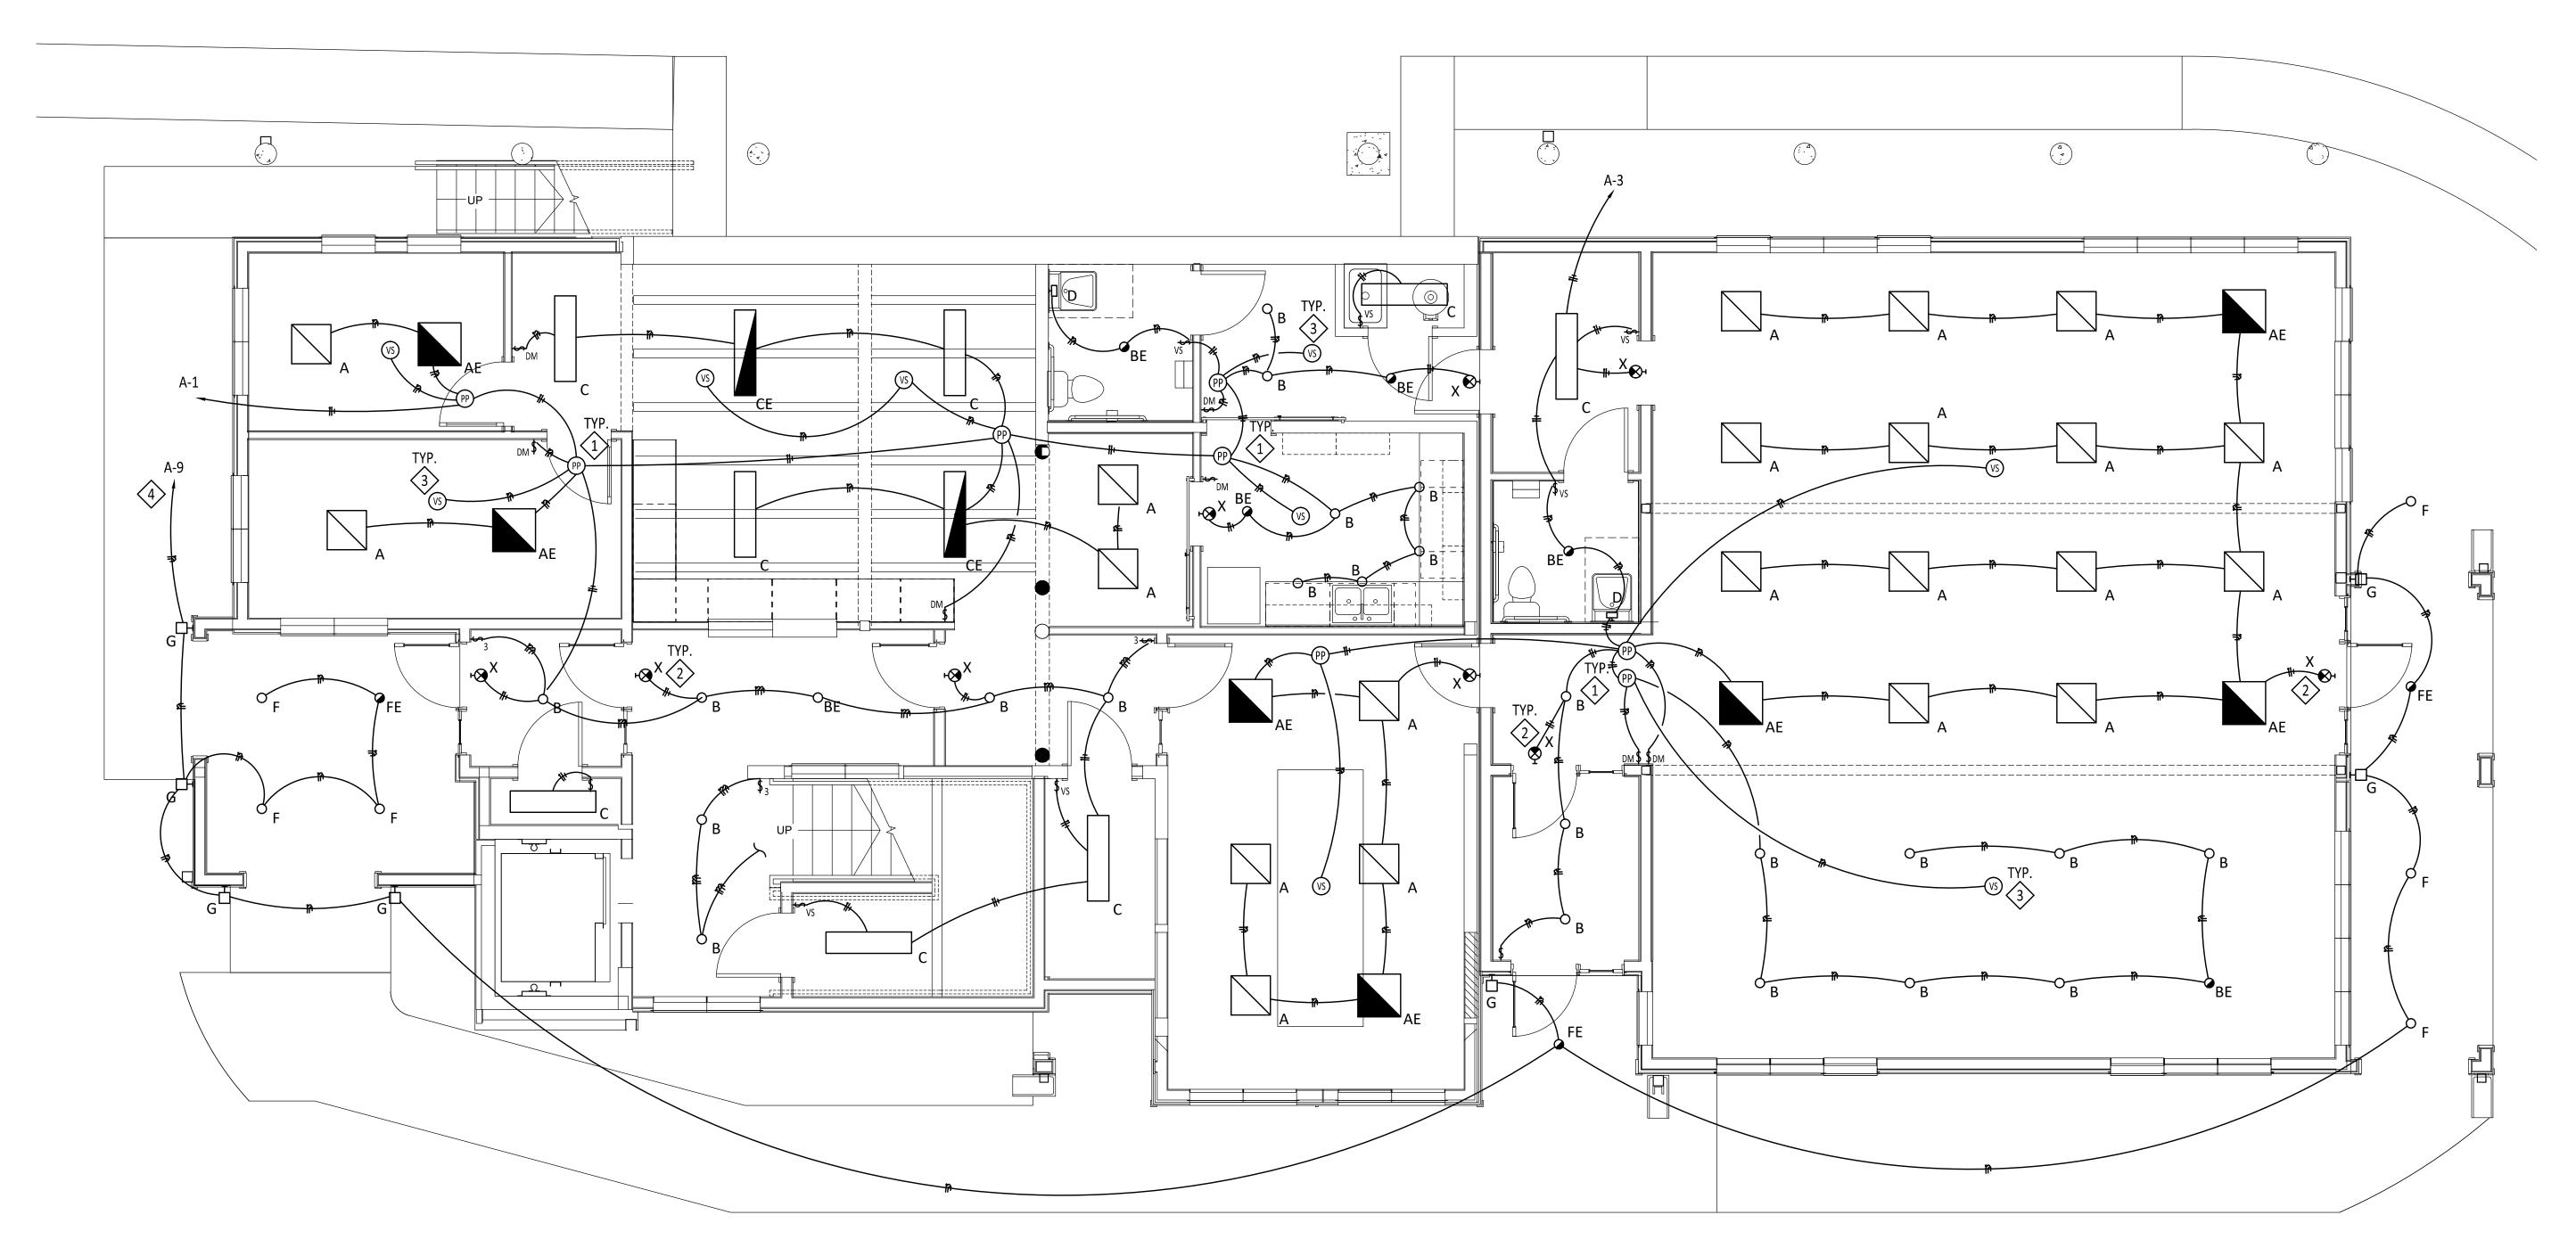

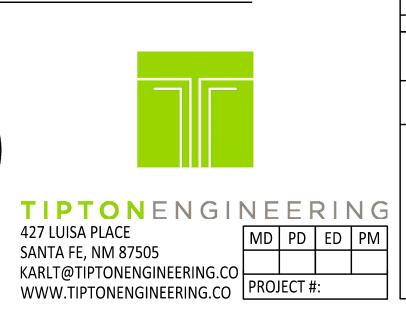

LIVING DESIGNS GROUP ARCHITECTS

> 122A Doña Luz St. Taos, NM 87571 t: 575. 751. 9481 www.ldgtaos.com

ADMINISTRATION

PROJ. NO: 2018-600 ISSUE DATE: 10/18/18 ISSUED FOR:

CONSTRUCTION

REVISIONS:
NO DATE DESCRIPTION

DRAFTED BY: APPROVED BY:

SCALE: As indicated

ELECTRICAL LIGHTING PLAN

E101